APPROVED

By Warren Jones at 11:33 am, Oct 10, 2022

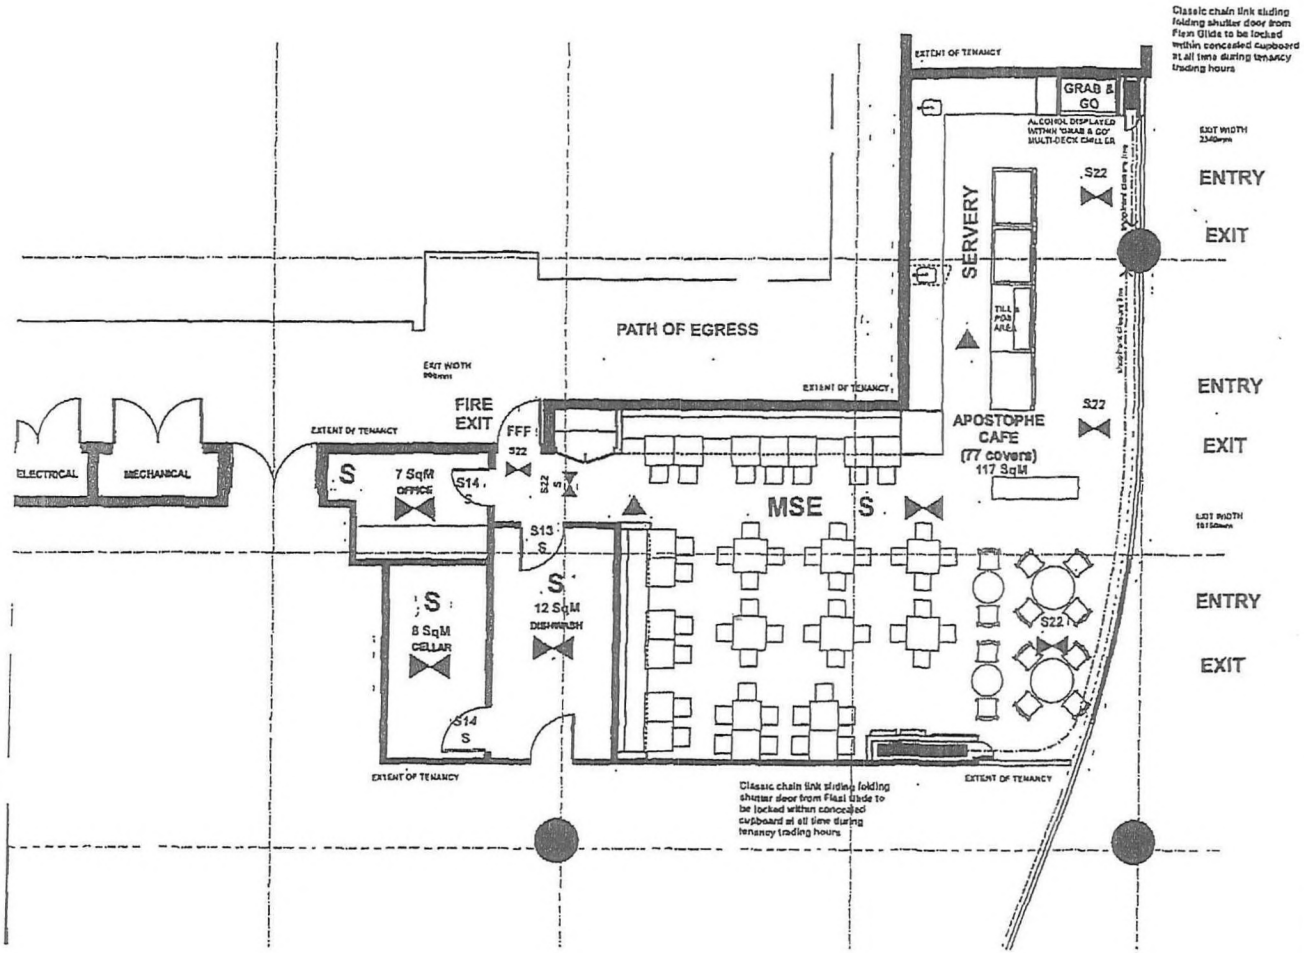

FLOOR PLAN

LEGEND

▲	Carbon Dioxide Fire Extinguisher
	Water Fire Extinguisher (6 litre)
⧗	Area covered with escape lighting to comply with current British Standards
S22 S ⧗	Internally illuminated fire exit sign suspended above head height at right angles to escape route with the graphic symbol on the approach side to comply with current British Standards
S22 ⧗	Internally illuminated fire exit sign suspended above head height with graphic symbol on the approach side to comply with current British Standards
S13 S	44mm thick solid core fire door kept shut to comply with British Standards
S14 S	44mm thick solid core fire door kept lock to comply with British Standards
FFF	Doors which are to be free from fastenings (other than fire related compliant hardware)
	Area covered by Automatic Sprinkler to comply with current British Standards
S	Area covered by Automatic Smoke Detectors to comply with current British Standards
MSE	Area covered by Mechanical Smoke Extraction to comply with current British Standards
	Fire Alarm Call Point to comply with current British Standards

Figured dimensions only are to be taken from this drawing. All dimensions are to be checked on site before any work is put in hand. If in doubt, ask.

NOTES

C	Additional notes	SP SP	18.11.10	EH
B	For Review	SP SP	17.11.10	EH
A	Preliminary layout	SP SP	09.11.10	EH
Rev	Description	Drawn	Date	Checked

shh ©

Project: Apostrophe

Drawn: SP | Site Address: Gatwick Airport

Checked: EH | Client: The Restaurant Group

Title: 400 Internal Elevations and Details
Liquor License layout

Status	Scale At A1	Scale At A3
Construction	1:50	1:100
Project no. / Stage / Drawing no.	Date	Revision
661(SK)406	07/10/10	C